

RESOLUTION NO. 2025-019

RESOLUTION 2025-019 SELECTING 1300 BLOCK ELM AVENUE AS THE CITY OF IMPERIAL BEACH'S 20A PROJECT; AND ALLOCATING ALL 20A WORK CREDITS FROM SDGE IN THE AMOUNT OF \$2,197,966 TO THE PROJECT

WHEREAS, in 2016, the City Council adopted Resolutions 2016-7669, 2016-7670, and 2016-7671 establishing underground utility districts in the 1300 block of Donax Avenue, the 1300 block of Elm Avenue, and the 900-1000 blocks of Fern Avenue respectively; and

WHEREAS, the City's Rule 20A work credits in the amount of \$2,197,966 are set to expire if they are not designated to an "Active" project; and

WHEREAS, in order to meet the requirements of an "Active" project, the City must designate a project and allocate all the funds necessary to complete the project through a resolution adopted by the City Council; and

WHEREAS, the 1300 Block Elm Avenue Project, more particularly shown in the 1300 Block Elm Avenue Project Boundary Map attached as Exhibit A, is estimated by SDGE to have a total project cost of \$1,889,263.

NOW, THEREFORE, BE IT RESOLVED by the City Council of the City of Imperial Beach as follows:

1. The above recitals are true and correct.
2. The 1300 Elm Avenue Project is designated as the City's 20A Project; and
3. The balance of the City of Imperial Beach's Rule 20A funds totaling \$2,197,966 are allocated to the 1300 Block Elm Avenue Project.

PASSED, APPROVED, AND ADOPTED by the City Council of the City of Imperial Beach at its meeting held on the 16th day of April 2025, by the following vote:



AYES:	COUNCILMEMBERS:
NOES:	COUNCILMEMBERS:
ABSENT:	COUNCILMEMBERS:

PALOMA AGUIRRE, MAYOR


ATTEST:

JACQUELINE M. KELLY, MMC
CITY CLERK

ELM AVE

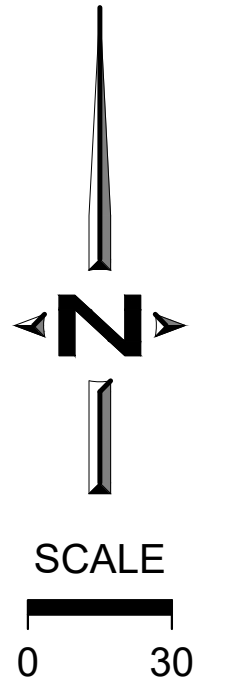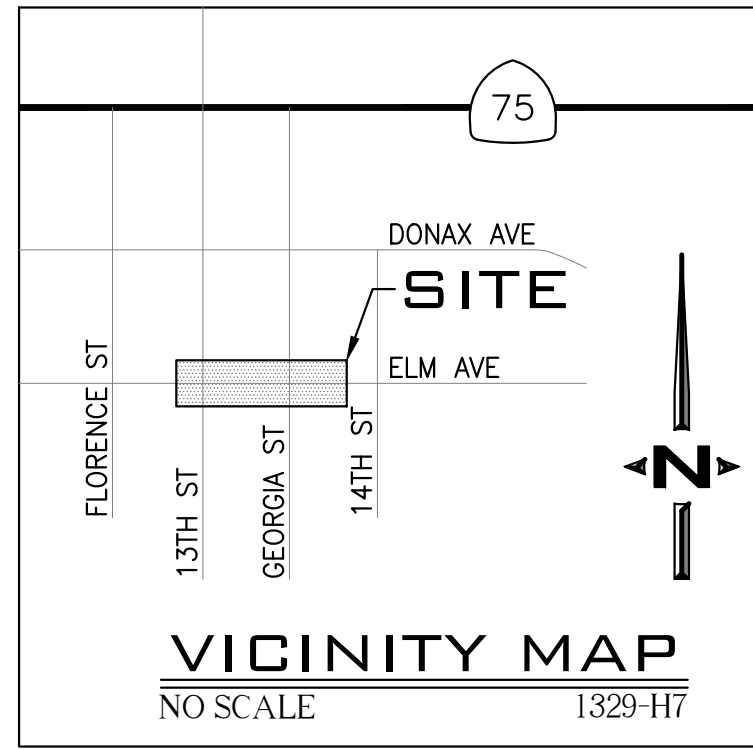

H117468
EX. 3315
W.O. 2606410

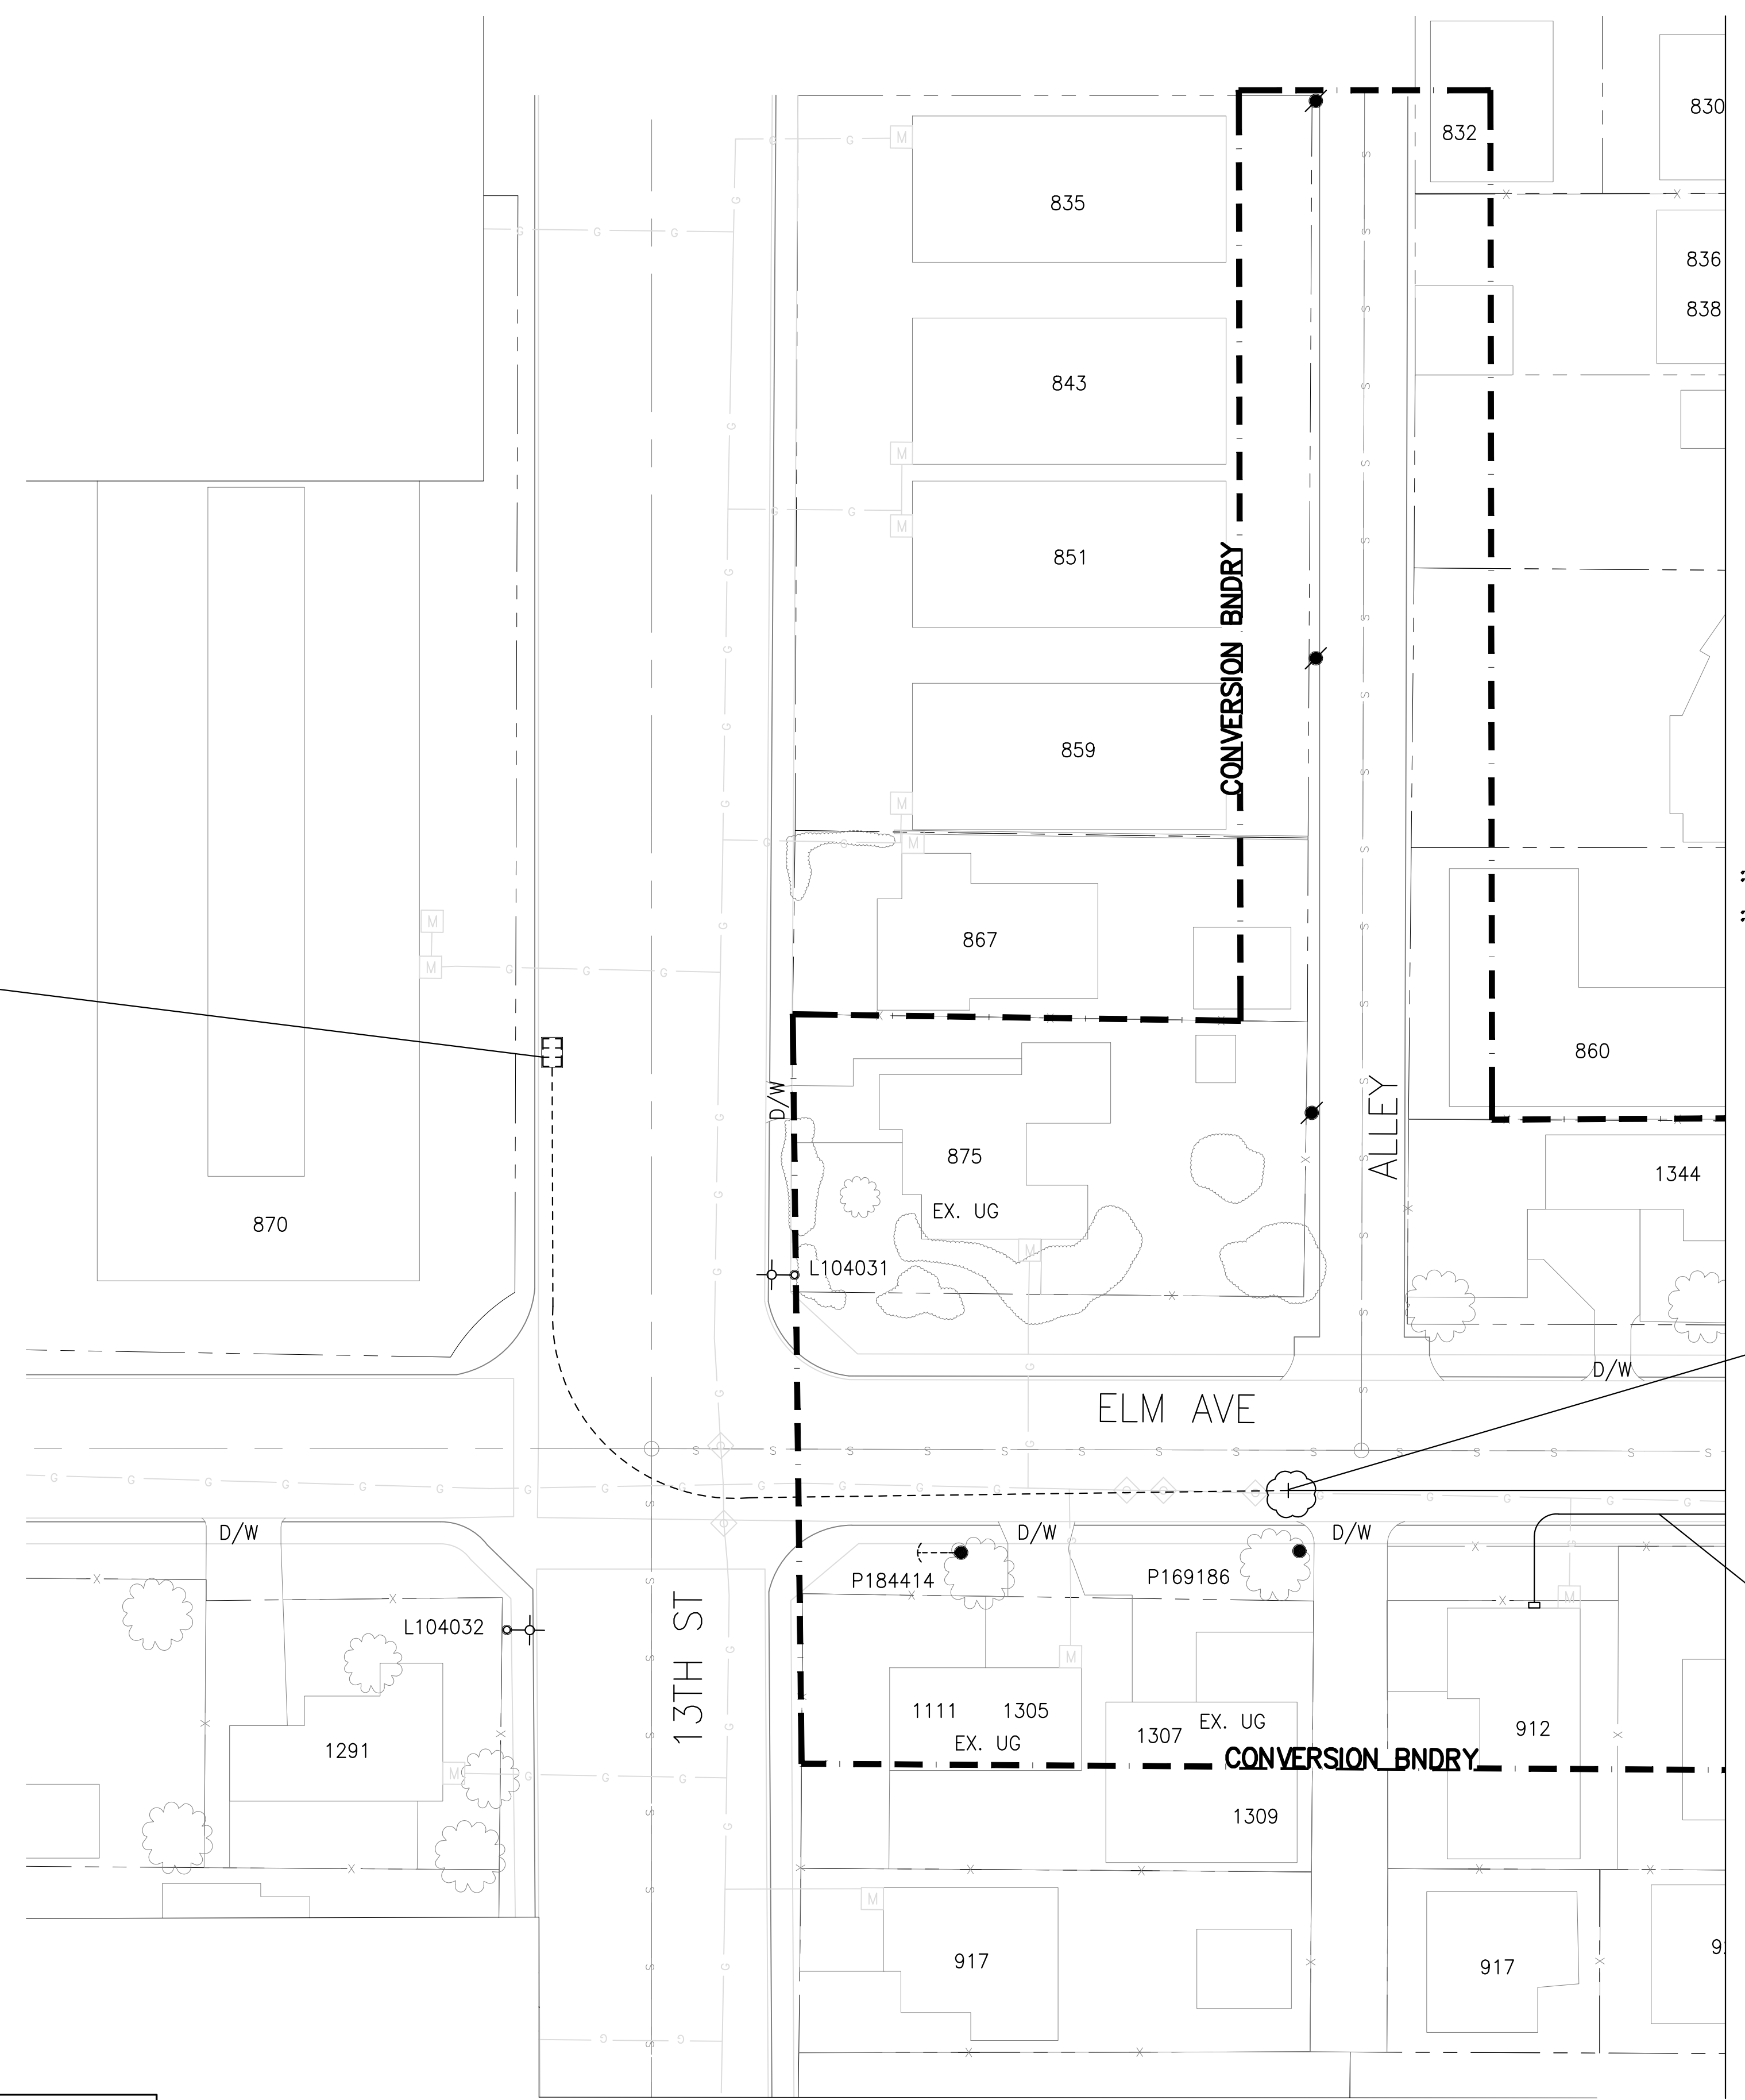

CONVERSION NOTES

- MAINTAIN A MINIMUM OF 5' SEPARATION WHEN PARALLELING WET UTILITIES AND 6" WHEN CROSSING.
- CLOUDED AREAS IDENTIFY POINT OF INTERCEPT/RE-ROUTE OF EXISTING UNDERGROUND FACILITIES. ALL EXISTING ENERGIZED CONDUIT TO BE IDENTIFIED AND ALIGNED WITH NEW CONDUIT STUB FOR FUTURE INTERCEPTS ON CABLE JOB W.O. _____.
- ALL COMMERCIAL INTERCEPT LOCATIONS TO BE WORKED ON DOUBLE TIME.
- FINAL STREET REPAIR OF ALL INTERCEPTS RESPONSIBILITY OF CABLE CREW.
- CAUTION: ELECTRIC STANDBY BY LINEMAN REQUIRED FOR ALL WORK AROUND ENERGIZED FACILITIES.
- ALL CROSSED OFF LOCATION BOXES ON THIS JOB HAVE BEEN OMITTED.
- ALL SERVICE CONDUITS FOR COMMUNICATION COMPANIES TO BE INSTALLED ON THIS JOB AS REQUIRED PER JOINT TRENCH AGREEMENT.
- ALL NEW UG SERVICE CABLE IS ON THE CONVERSION SERVICE WORKSHEET AND WILL BE INSTALLED AT A FUTURE DATE.
- EXISTING OH ELECTRIC SERVICES WITHIN CONVERSION BOUNDARY TO BE REMOVED ON THIS WORK ORDER.
- REMOVE ALL OH ELECTRIC DISTRIBUTION WIRE WITHIN CONVERSION BOUNDARY UNLESS OTHERWISE NOTED.
- T-TRENCH CONSTRUCTION PER REGIONAL STANDARDS WHEN REQUIRED BY MUNICIPALITY.
- ALL QUESTIONS RELATED TO SERVICE TRENCH SHOULD BE DIRECTED TO THE APPROPRIATE LIAISON PLANNER.
NAME _____ PHONE _____

X 1-4" PRI INTERCEPT & EXTEND
STANDBY LINEMAN REQUIRED



X 1-3" SVC.



Call 811: Two Working Days Before You Dig!

San Diego Gas & Electric Design & Construction Management <small>A Sempra Energy Utility</small>	PROJECT NOTIFICATION #	300000438901
	JOB NOTIFICATION #	300000438859
PROJECT MGR./PLANNER NAME & PHONE: DENNIS GERSCHOFFER (858)987-2940	DATE:	4/5/22
DESIGNED BY:	JENNIFER MANN	SHEET BM01 SHT 1 OF 2
REVIEWED BY:	REVIEWER NAME	

ELM AVE

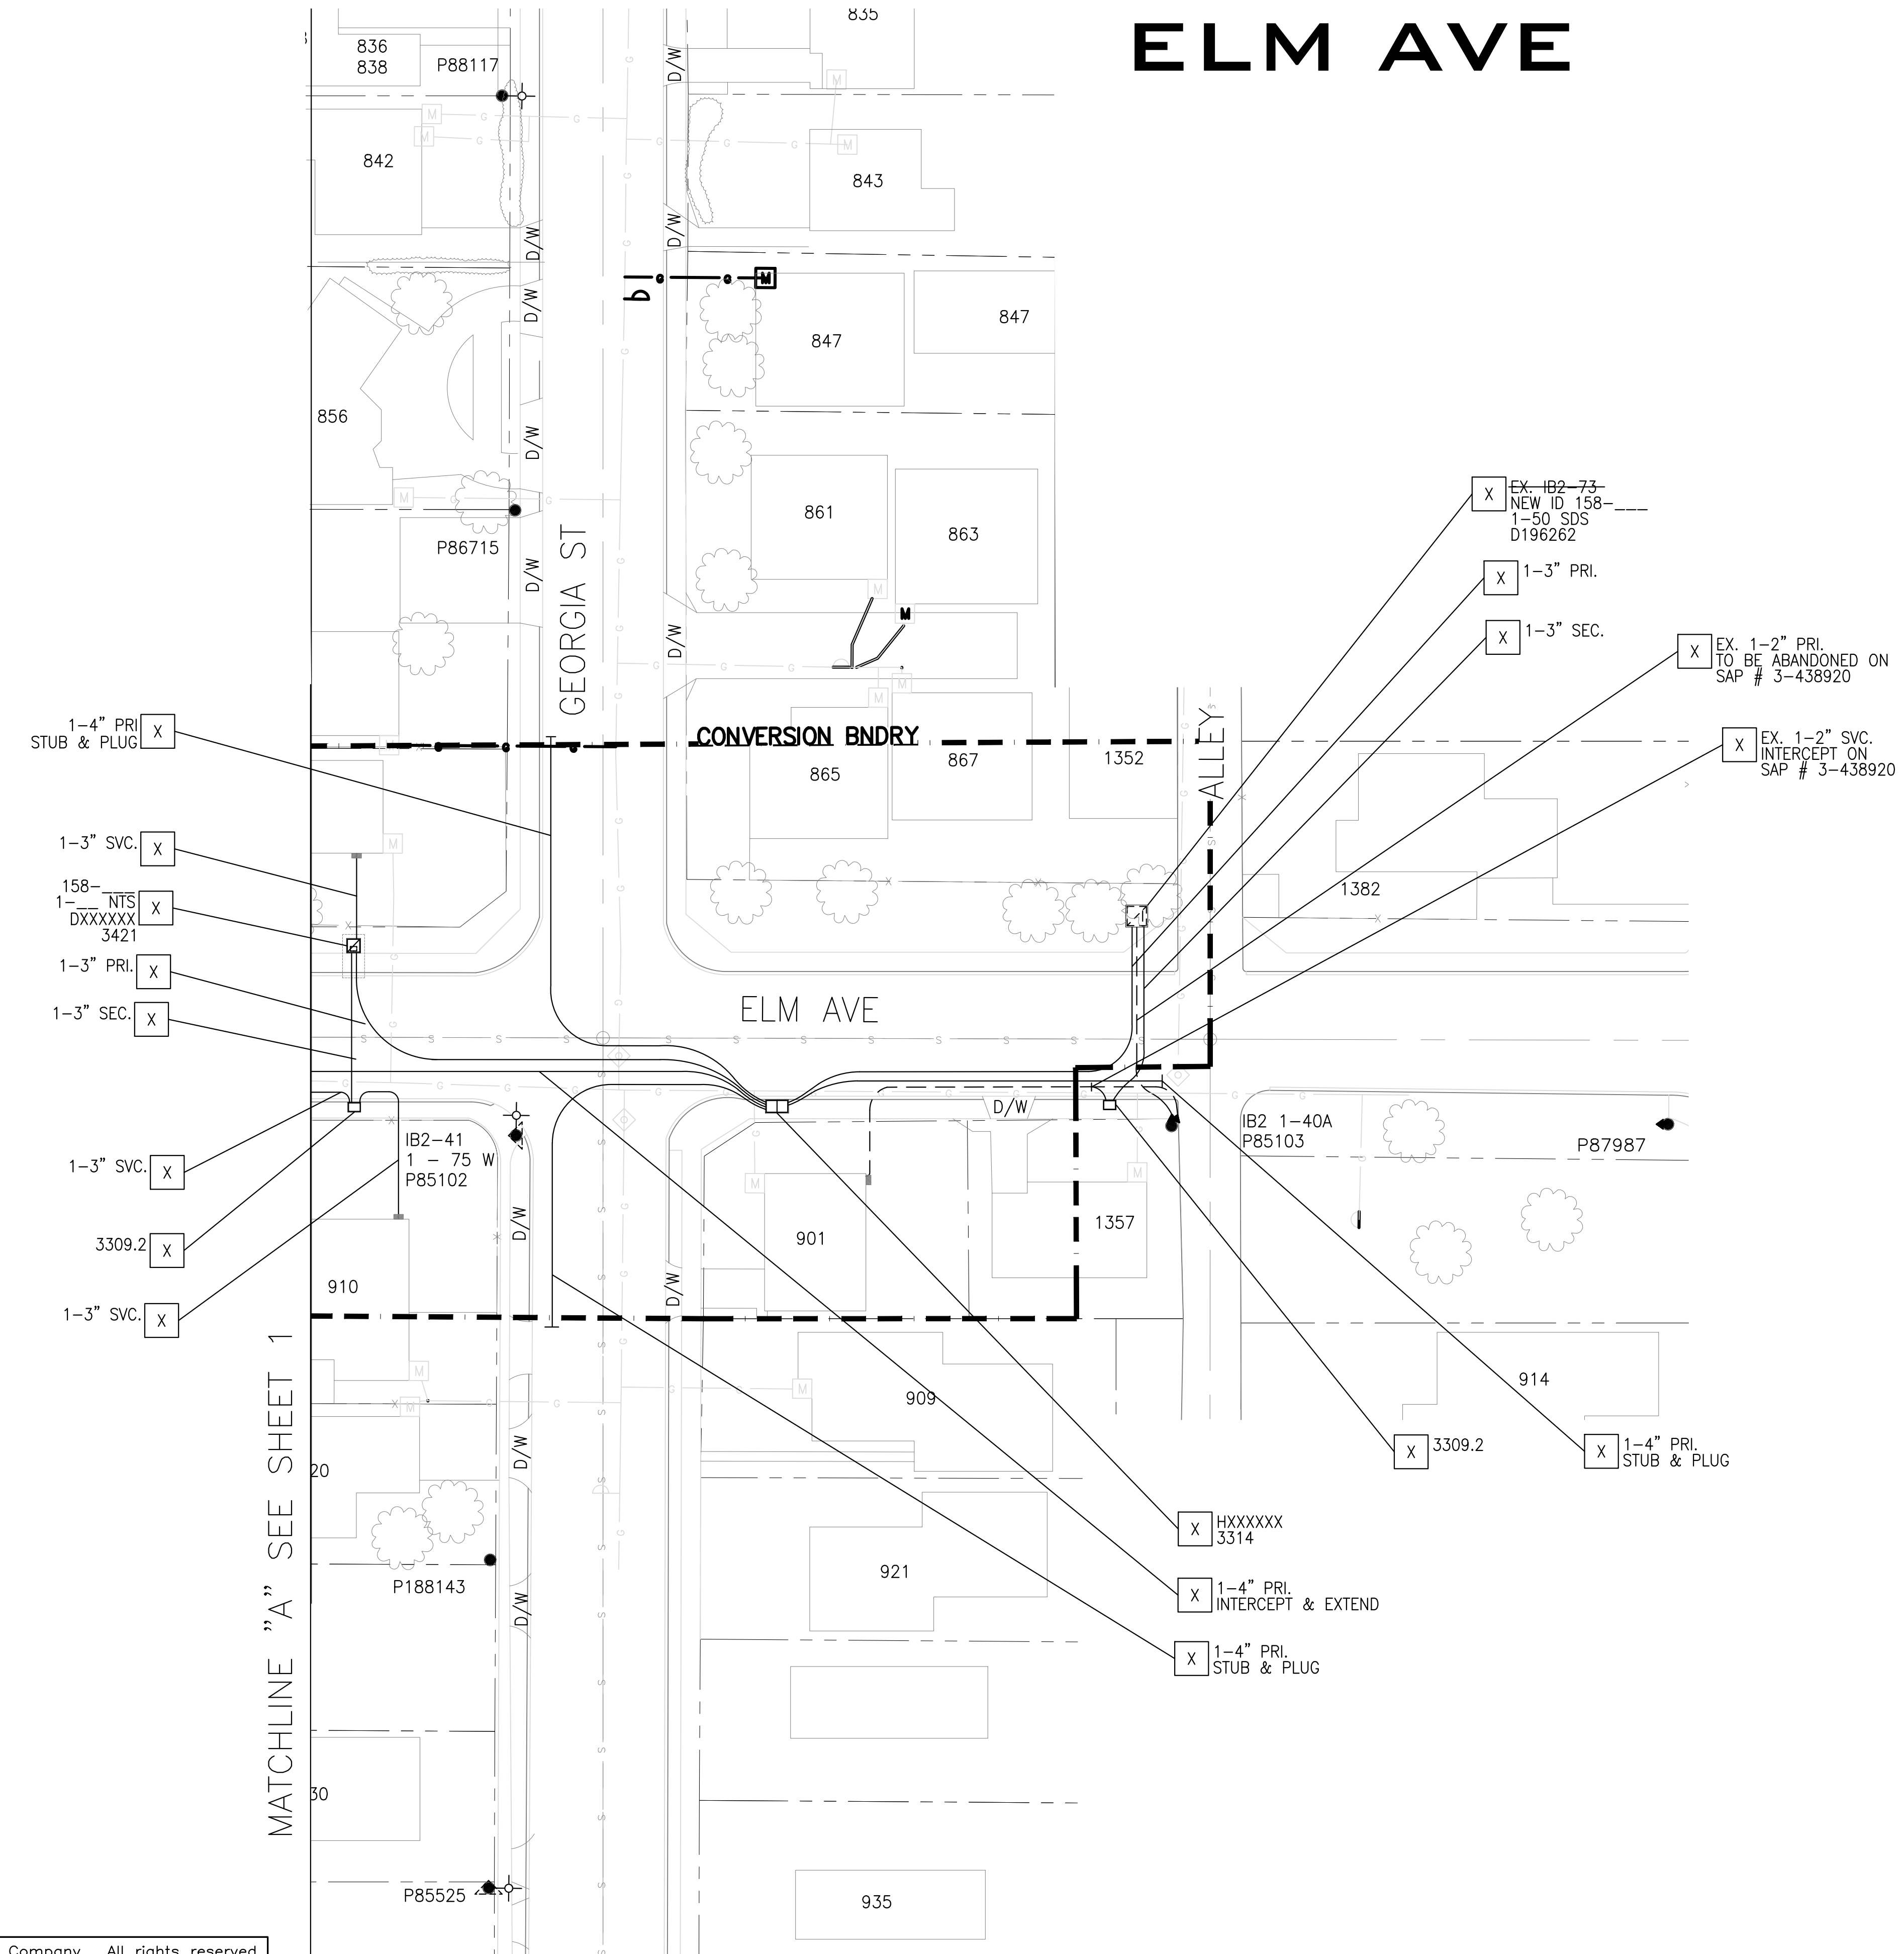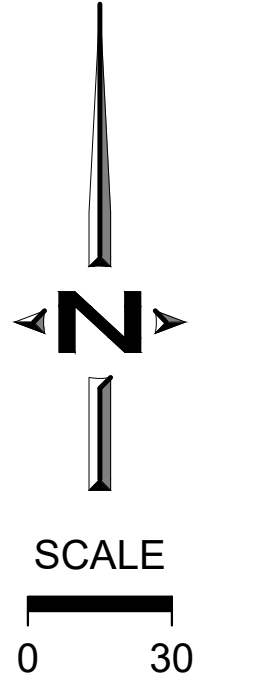

MATCHLINE "A" SEE SHEET 1

San Diego Gas & Electric Design & Construction Management <small>San Diego Gas & Electric Company</small>	PROJECT NOTIFICATION #	300000438901
	JOB NOTIFICATION #	300000438859
PROJECT MGR/PLANNER NAME & PHONE: DENNIS GERSCHOFFER (858)987-2940	DATE:	4/5/22
DESIGNED BY: JENNIFER MANN	SHEET	FCO
REVIEWED BY: REVIEWER NAME	BM02	00
	SHT 2 OF 2	